



Power Diagnostix

About Power Diagnostix

Power Diagnostix Systems GmbH provides quality instruments and engineering services for high voltage diagnostic applications. Power Diagnostix has built a solid reputation since market introduction of our partial discharge detectors in early 1993. Our ICM series of digital partial discharge detectors is used for evaluation of electrical insulation by electric utilities, manufacturers, and research institutes worldwide.

In addition to digital partial discharge detectors and monitoring systems, Power Diagnostix produces instruments for commissioning tests of GIS systems, automated control of high voltage tests, fibre optic connections for analogue signal transmission between instruments and sensors, and for other applications in high voltage. All of our instruments and specialised software products are developed in Aachen, Germany. The company's principal engineers are active in several scientific committees.

In June 2019, Power Diagnostix became a part of the Megger group.

At Power Diagnostix, we understand that keeping the power on is essential for the success of your business. That is why we are dedicated to creating, designing, and manufacturing safe, reliable, easy-to-use portable test equipment and professional technical services backed by world-leading support and expertise.

We can assist your acceptance, commissioning, and maintenance testing for predictive diagnostic or routine purposes. By working closely with electrical utilities, standards bodies and technical institutions, we contribute to the dependability and advancement of the electrical supply industry ... keeping the power on.

Our engineers actively participate in regulars' committees, meetings with all the big trade associations around the world, training organisations, and government organisations, to understand the needs of electrical contractors. So, when new legislation or rules are introduced, you can count on Power Diagnostix to put your interests first, because Power Diagnostix products and services help customers all over the world, improving their efficiency, reducing costs, and meeting standards. We operate globally, with dedicated field sales teams and distributors located all over the world.

Power Diagnostix is certified according to ISO 9001:2015, ISO 14001:2015, and ISO 45001:2018. We offer full service, repair, and calibration service accredited to ISO 17025:2018.




Partial discharges in transformers	4
Importance of the insulation system.....	4
Most common causes of PD in transformers.....	4
Nature of partial discharge	5
Continuous on-line PD monitoring with ICM <i>monitor</i>	6
ICM <i>monitor</i>	8
Acquisition unit	8
Features.....	8
PD acquisition monitoring rack PDMAR500.....	9
Communication	10
ICM <i>monitor</i> software	11

Partial discharges in transformers

IMPORTANCE OF THE INSULATION SYSTEM

Partial discharge testing is required in order to be able to assess the quality of the power transformers. In an electric system, the failure of the insulation may ultimately lead to a complete breakdown. It has been found out that a high percentage of failures is related to insulation problems concerning the power transformers.

PD monitoring helps detecting insulation, bushing, and winding problems. Failures can be due to an improper factory acceptance test (FAT), transportation as well as onsite commissioning. Random failures are caused by particular stress such as high load, lightning, or switching impulses.

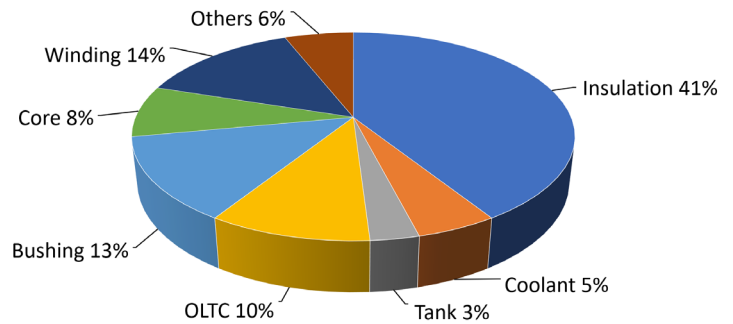


MOST COMMON CAUSES OF PD IN TRANSFORMERS

The most common causes of PD in transformers are:

- Sharp points and particles
- Surface and tracking discharge
- Fibre bridges in oil
- Gas inclusions
- Humidity (indirect)

Online PD monitoring is important to assess the insulation condition of power transformers as well as transformer accessories. PD trending and changing PD patterns help to indicate an incipient failure. Further analysis of the phase-resolved PD pattern assists with failure investigation in order to find out the root cause. In addition, PD monitoring can be extended to DGA, voltage, tan delta, temperature, and load monitoring.

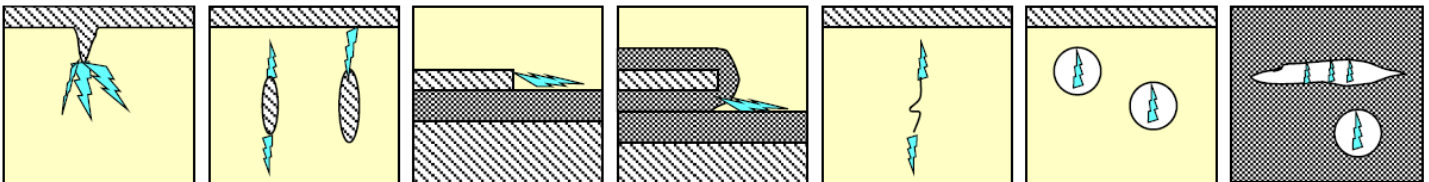


Partial discharges in transformers

NATURE OF PARTIAL DISCHARGE

Partial discharge is a breakdown of a small area in the overall insulation, and each PD signal generates different measurable electrical signals. These are:

- Local displacement current pulses
- Electromagnetic pulses
- Acoustic signals

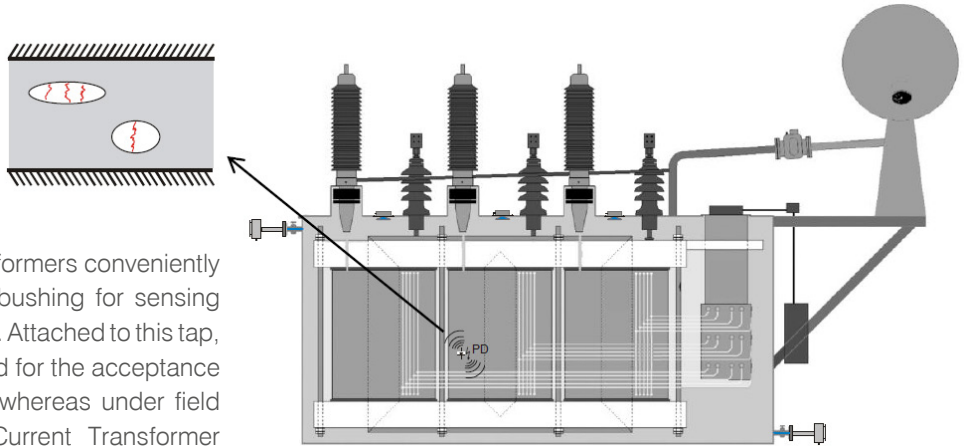

Partial discharge monitoring on power transformers conveniently uses the capacitive tap of the condenser bushing for sensing both partial discharge and line voltage signal. Attached to this tap, the combined measuring impedance is used for the acceptance testing in the IEC 60270 frequency range, whereas under field conditions the built-in High Frequency Current Transformer (HFCT) can be used.

General root causes of PD in power transformers are:


- Inferior quality of insulation materials
- Fundamental design related problems
- Assembling related problems
- Humidity in oil
- Aging of insulation materials
- Hot spots

Partial discharges have a severe impact on transformer insulation systems, and this depends on the nature of the PD and the location in the main tank. Accordingly, accelerated degradation of the insulation material leads to reduced life expectancy of the grid system. The worst case scenario is the unexpected breakdown resulting in blackouts. With diagnostic testing, the main task is to analyse the partial discharge pattern to assess the risk potential of the degradation process and subsequently to determine the location of the partial discharge source.



Continuous on-line PD monitoring with ICMmonitor

Continuous online PD monitoring or periodical online measurements help to detect incipient faults.

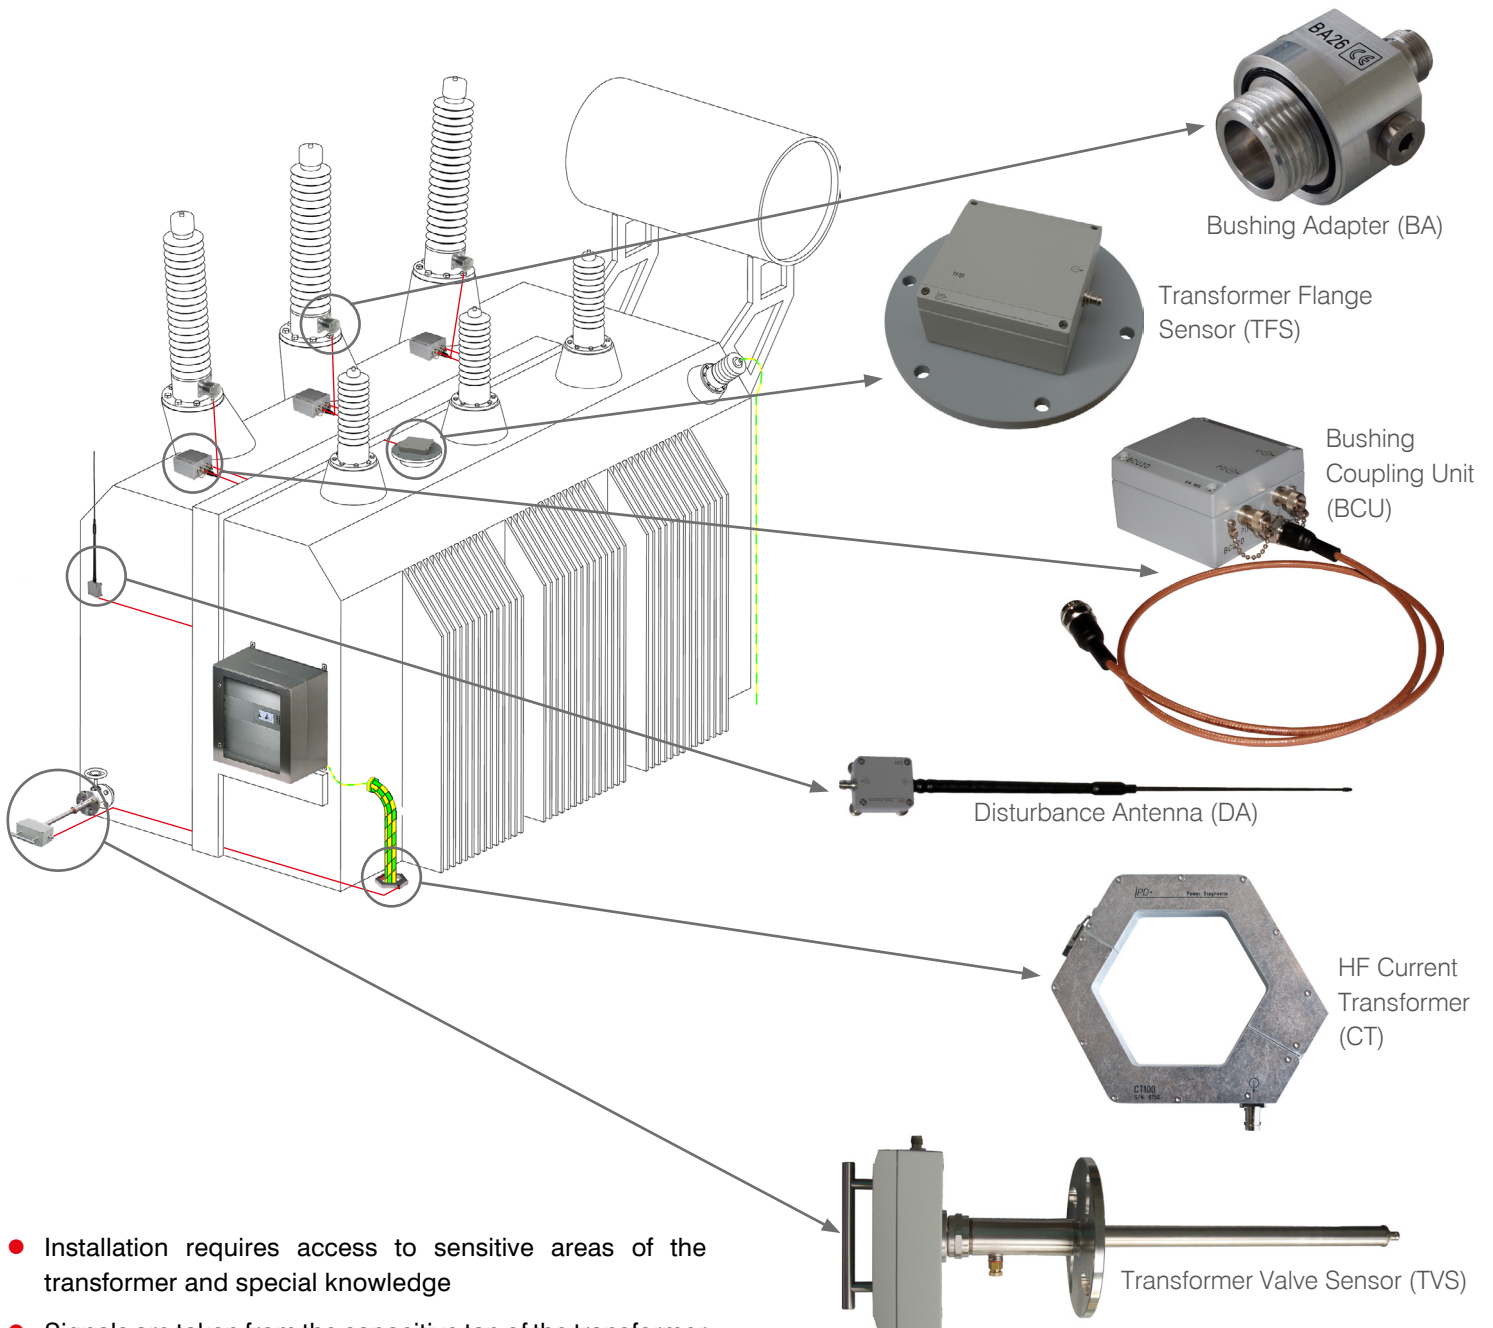


- Installation requires access to sensitive areas of the transformer and special knowledge
- Signals are taken from the capacitive tap of the transformer bushing by bushing adapter (BA) and bushing coupling unit (BCU)
- UHF sensors are available for the oil drain valve (TVS2) and for spare flanges (TFS1)
- Gating signal from optional disturbance antenna (DA1) or high frequency current transformer (CT)

Continuous on-line PD monitoring with ICMmonitor

Monitoring the partial discharge activity continuously on-line on a power transformer unveils deterioration of the insulation system in an early stage. Continuous online monitoring of the partial discharge activity and the bushing capacitance helps maintaining the reliability of power transformers.

Coupling to the partial discharge signals is conveniently provided by using the capacitive taps of the condenser bushing. Since a huge variety of capacitive taps designs exists, Power Diagnostix offers various versions of tap adapter units.

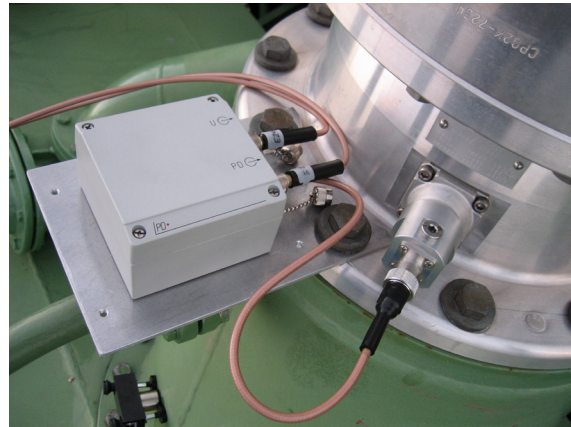

Stainless steel box for offshore applications

The coupling unit is equipped with circuits both for the measurement of voltage and of partial discharge. For the PD measurement both a high frequency current transformer and a standard quadrupole is built-in.





External disturbances can be detected by an antenna, e.g., DA1, or by a clamp-on HF current transformer (CT1, CT100, or similar).

ICMmonitor

ACQUISITION UNIT

The ICMmonitor is a stand-alone unit for the continuous online monitoring of PD activity. For each channel the unit acquires a phase-resolved PD pattern. Trending curves are stored locally.

The system can be adapted to utilise all commonly used types of couplers and sensors. It offers a relay output to give a warning if a preset threshold level is exceeded. Alarm levels can be set for the average discharge current as well as for the peak level of discharge.

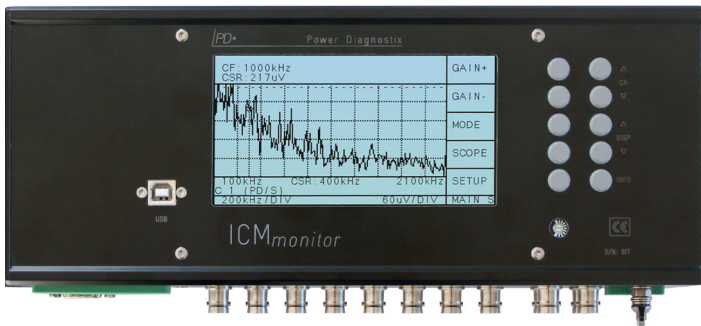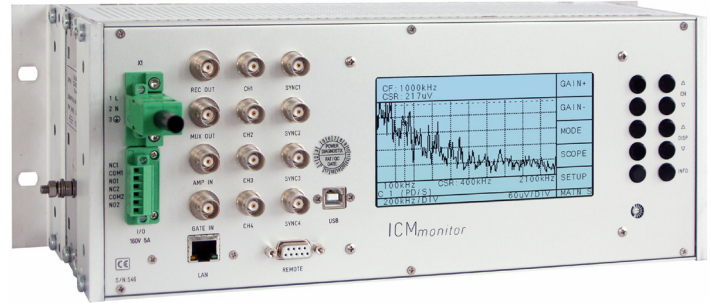

The ICMmonitor can also be installed on a power transformer with a waterproof enclosure. The unit can be integrated into a larger monitoring concept, in case the discharge activity correlates with other operational parameters such as load, temperatures, or gas-in-oil analysis.

Furthermore, the ICMmonitor can be used with embedded UHF sensors along with special demodulating UHF preamplifiers. The UHF band offers noise-free measurements on discharges coming from faults within the transformer tank, for instance.

FEATURES



- Frequency selective measurements
- Wide band and narrow band filter
- Spectrum analysis
- Dry alarm contacts
- IEC 61850 (optional)
- USB interface
- LAN interface





PD ACQUISITION MONITORING RACK PDMAR500

- Compact design
- Built-in ICMmonitor, CTB, network interface, IOs, main switch,...
- User-friendly interface
- Corrosion proved design
- High quality PTFE coaxial cables suited for extreme weather conditions on site
- Heating installation or cooling system possible
- Stainless steel enclosure with protection class IP52 or special Explorer case with protection class IP65

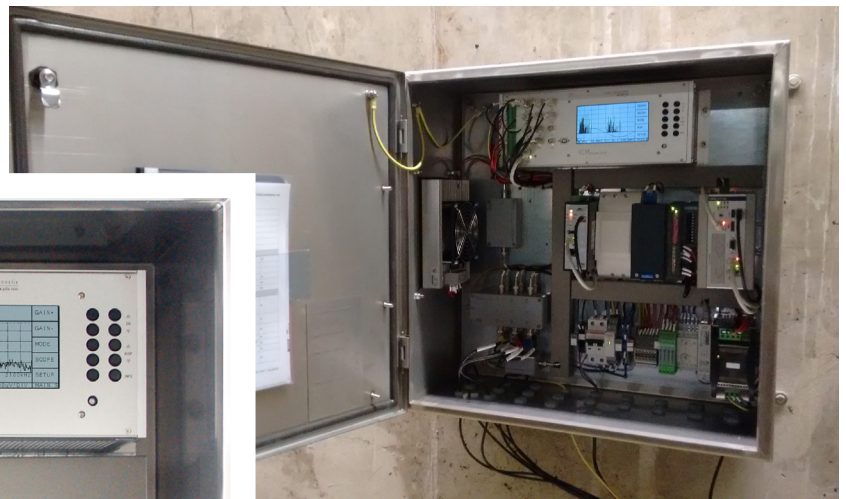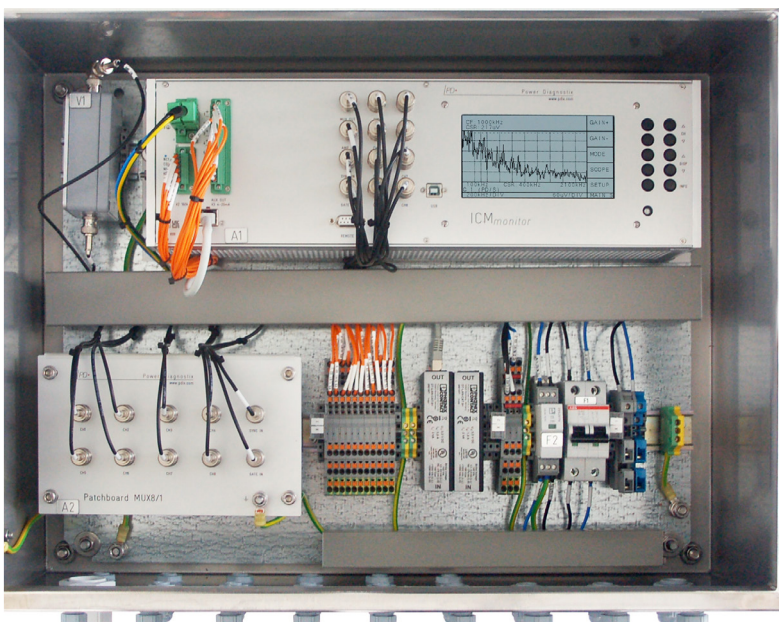

ICMmonitor

COMMUNICATION


The ICMmonitor is equipped with a serial computer interface for downloading of trending data and remote access, e.g., by telephone modem or LAN network (TCP/IP). The instrument talks to the local monitoring system covering temperatures, voltages, and other parameters, which then reports to the SCADA system.

There is an optional terminal for communication with the ICMmonitor according to IEC 61850. The hardware-based protocol converter for IEC 61850 compliant communication requires an additional terminal for communication via LAN that is used to transfer the data.


Furthermore, the Monitoring Web Server (MWS) provides an Ethernet gateway for platform independent remote access to an ICMmonitor device. To access the ICMmonitor remotely, only a modern web browser is required.

Combined with an LTE mobile router, a secure remote access via Internet can be provided.

Signal flow

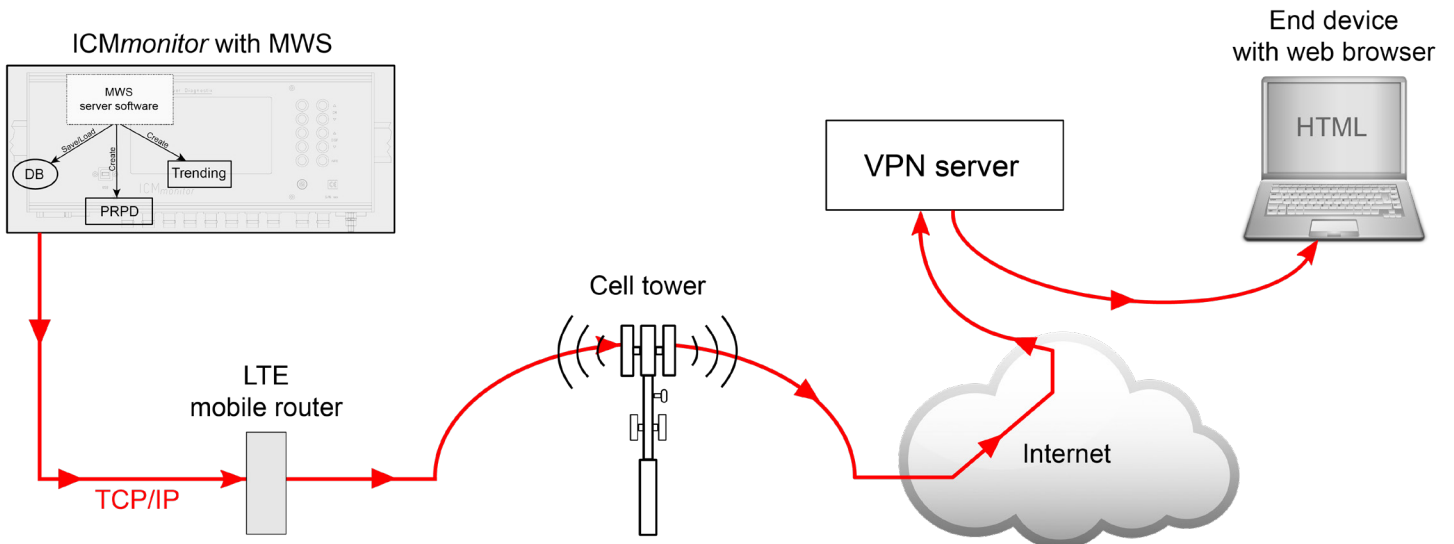

NQS and QP trending panel and landing page of the MWS application

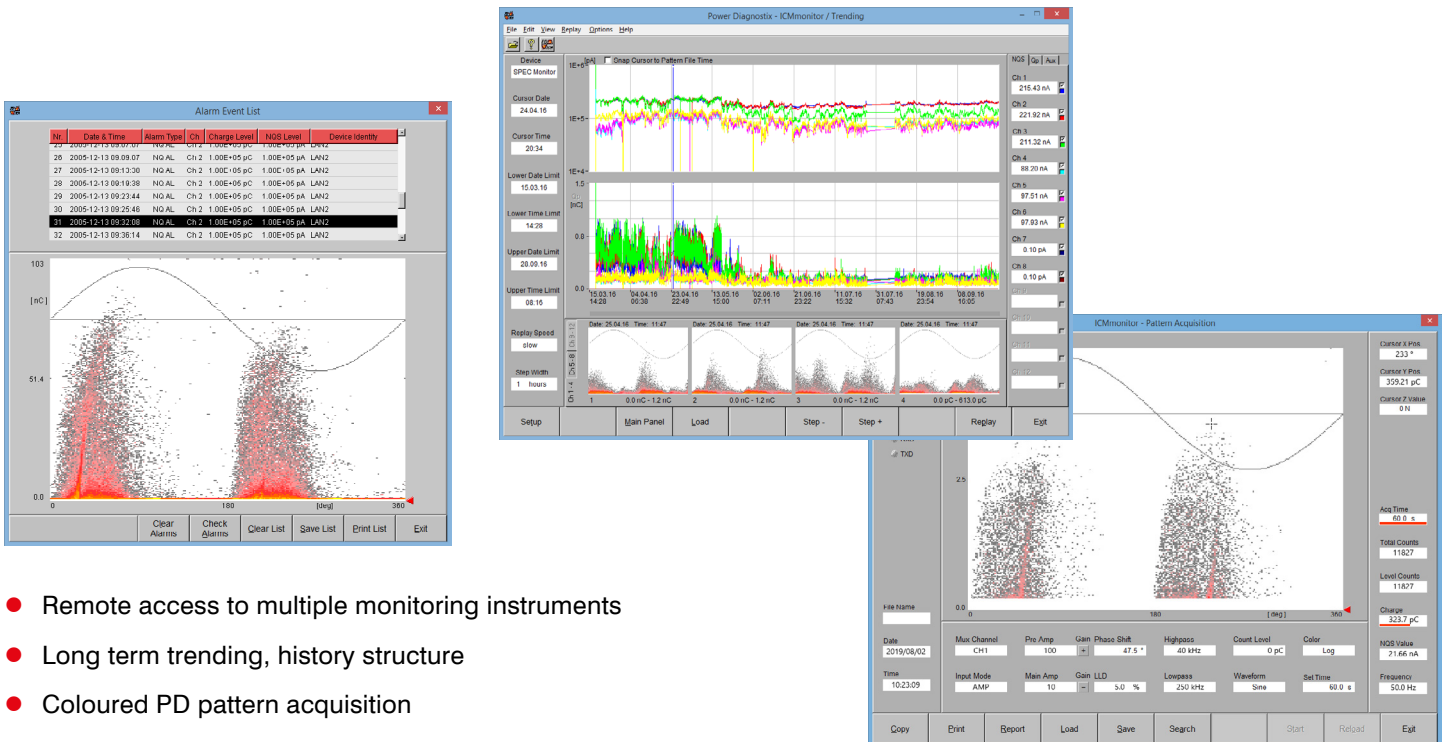

- Remote access to multiple monitoring instruments
- Long term trending, history structure
- Coloured PD pattern acquisition
- Automated data acquisition
- USB and LAN interface

SOLUTIONS THAT FIT FOR YOU

According to your specific needs Power Diagnostix provides the PD monitoring system that fits exactly to your requirements. Get in touch with us for a detailed quotation. For that purpose we need the following information:

- Tested assets
- Technical details of the asset (nameplate, specification)
- Environmental conditions
- On-line or off-line test conditions?
- Applicable or relevant standards, guidelines, or TBs

Typical package

Complete PD monitoring system for power transformers:

- 1 x ICMmonitor (incl. SPEC and gating function)
- 1 x ICMmonitor software
- 1 x Industrial monitoring cabinet (sheet metal or stainless steel)
- 1 x Analogue input card for parallel recording of misc. sensor signals like temperatures, vibrations, load conditions, etc.
- 1 x Preamplifier RPA2B
- 1 x Preamplifier RPA1H
- 1 x High frequency current transformer CT1
- 1 x Impulse calibrator CAL1B
- 1 x Set of cables
- 1 x Set of three bushing coupling units BCU2D
- 1 x Set of bushing adapters BAXy (BA1–BA32)
- 1 x Mounting kit for PD decoupling units



Power Diagnostix Systems GmbH
Vaalser Strasse 250, 52074 Aachen, Germany
Tel. +49 241 74927, Fax. +49 241 79521
E-Mail: support(at)pdix.com

www.pdix.com

TrafoMon e1.06

The word 'Megger' is a registered trademark. Copyright © 2024

PD  **by Megger®**
Power Diagnostix Systems